



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)  
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY  
PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208  
Miami, Florida 33175-2474  
T (786) 315-2590 F (786) 315-2599

[www.miamidade.gov/economy](http://www.miamidade.gov/economy)

## NOTICE OF ACCEPTANCE (NOA)

**Exeter Architectural Products**  
242 West 8<sup>th</sup> Street  
Wyoming, PA 18644

### SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER- Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

### DESCRIPTION: Storm Shield Fixed Hurricane Barrier

**APPROVAL DOCUMENT:** Drawing No. SSHB-E, titled "Storm Shield Hurricane Barriers", sheets 1 through 4 of 4, prepared by Exeter Architectural Products, dated September 08, 2008, last revision #R2 dated February 12, 2009, signed & sealed by Thomas H. Maxwell Jr., P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and the expiration date by the Miami-Dade County Product Control Section.

### MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

**LABELING:** Each panel shall bear a permanent label with the manufacturer's name or logo, city, state, the following statement: "Miami-Dade County Product Control Approved", NOA number, and TAS-201, TAS-202, and TAS-203, unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA #08-1007.05 and consists of this page 1, evidence submitted pages E-1 and E-2 as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P.E.**



*J. Gascon*  
12/10/12

NOA No. 12-1019.17  
Expiration Date: 03/18/2014  
Approval Date: 12/20/2012  
Page 1

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**1. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 08-1007.05**

**A. DRAWINGS:**

1. *Drawing No. SSHB-E, titled " Storm Shield Hurricane Barriers ", sheets 1 through 4 of 4, prepared by Exeter Architectural Products, dated September 08, 2008, last revision #R2 dated February 12, 2009, signed & sealed by Thomas H. Maxwell Jr., P.E.*

**B. TESTS:**

1. *Test report on TAS201-Large Missile Impact Test, TAS202-Uniform Static Air Pressure Test and TAS203-Cyclic Wind Pressure Test of Stainless Steel Hurricane Barrier, prepared by Architectural Testing, Report No. 79734.01-109-18, dated 06/13/2008, signed and sealed by Michael D. Stremmel, P.E.*
2. *Test report on TAS201-Large Missile Impact Test, TAS202-Uniform Static Air Pressure Test and TAS203-Cyclic Wind Pressure Test of Galvanealed Hurricane Barrier, prepared by Architectural Testing, Report No. 80719.01-109-18, dated 04/14/2008, signed and sealed by Michael D. Stremmel, P.E.*

**C. CALCULATIONS:**

1. *Calculation titled 5' x 7' Single Hurricane Barrier and Anchor analysis, 6 pages, dated 09/24/2008, prepared by Thomas H. Maxwell Jr., P.E. , signed and sealed by Thomas H. Maxwell Jr., P.E.*
2. *Calculation titled Design Pressure Rating, 6 pages, dated 01/22/2009, prepared by Thomas H. Maxwell Jr., P.E., signed and sealed by Thomas H. Maxwell Jr., P.E.*

**D. QUALITY ASSURANCE:**

1. *By Miami-Dade building Code Compliance Office.*

**E. MATERIAL CERTIFICATION:**

1. *Tensile Test per ASTM E 8-03, prepared by Architectural Testing, Report No. 79734.01-109-18, dated 06/13/2008, signed and sealed by Michael D. Stremmel, P.E.*
2. *Tensile Test per ASTM E 8-03, prepared by Architectural Testing, Report No. 80719.01-109-18, dated 04/14/2008, signed and sealed by Michael D. Stremmel, P.E.*

**2. NEW EVIDENCE SUBMITTED**

**A. DRAWINGS:**


1. *None.*

**B. TESTS:**

1. *None.*

**C. CALCULATIONS:**

1. *None.*



Jaime D. Gascon, P.E.  
Product Control Section Supervisor  
NOA No. 12-1019.17  
Expiration Date: 03/18/2014  
Approval Date: 12/20/2012

**Exeter Architectural Products**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**D. QUALITY ASSURANCE:**

1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

**E. MATERIAL CERTIFICATIONS:**

1. *None.*

**F. OTHERS:**

1. *Letter of compliance with the Florida Building Code, 2010 Edition and ASCE 7-10, issued by Thomas H. Maxwell, Jr., P.E. Consulting Engineer, dated September 30, 2012, signed and sealed by Thomas H. Maxwell, Jr., P.E.*



---

Jaime D. Gascon, P.E.  
Product Control Section Supervisor  
NOA No. 12-1019.17  
Expiration Date: 03/18/2014  
Approval Date: 12/20/2012

GENERAL NOTES

1. THIS PRODUCT IS DESIGNED AS A HURRICANE/SECURITY SHUTTER
2. THESE PRODUCTS SATISFY THE FOLLOWING TESTING CRITERIA FOR LARGE MISSILE IMPACTS AND WIND LOADS IN ACCORDANCE WITH THE FOLLOWING STANDARDS:  
FLORIDA BUILDING CODE HIGH VELOCITY HURRICANE ZONE  
(TAS 201-94, TAS 202-94, TAS 203-94)
3. THIS PRODUCT HAS BEEN TESTED PER FLORIDA BUILDING CODE, TEST PROTOCOLS FOR HIGH VELOCITY HURRICANE ZONE, TO PROTOCOLS TAS 201-94, TAS 202-94, AND TAS 203-94.
4. EACH BARRIER SHALL HAVE A PERMANENT LABEL PLACED IN A VISIBLE LOCATION WITH THE FOLLOWING INFORMATION:

EXETER ARCHITECTURAL PRODUCTS  
WYOMING, PA  
MIAMI-DADE COUNTY  
PRODUCT CONTROL APPROVED

LABEL SIZE: 2" X 3/4"

EXETER ARCHITECTURAL PRODUCTS  
NANTICOKE, PA  
MIAMI-DADE COUNTY  
PRODUCT CONTROL APPROVED

ALTERNATE MANUFACTURING LOCATION

5. DESIGN PRESSURE CALCULATIONS SHALL BE PERFORMED BY A REGISTERED ARCHITECT OR PROFESSIONAL ENGINEER IN ACCORDANCE WITH ASCE 7-02. THE ALLOWABLE DESIGN PRESSURES FOR EACH PRODUCT TYPE (APPROVED UNDER THIS N.O.A.) ARE LISTED WITH ITS CORRESPONDING DRAWING.
6. ALL ALUMINUM PARTS ARE MADE FROM 6063 T5 SERIES ALUMINUM. THE PERFORATED PANELS SHALL BE .079" (NOMINAL THICKNESS) GALVANNEALED STEEL WITH AN OPTION FOR .079" (NOMINAL THICKNESS) STAINLESS STEEL. ALL PARTS SHALL BE SUPPLIED WITH A PROTECTIVE FINISH.
7. A FASTENER SCHEDULE FOR EACH PRODUCT CAN BE FOUND ON THE INDIVIDUAL DRAWINGS.
8. BARRIER CONSTRUCTION SHALL BE IN ACCORDANCE WITH DESIGNS AND METHODS SET FORTH BY THE MANUFACTURER CONTAINED HEREIN.
9. TO ENSURE PROPER OPERATION, INSTALLATION SHALL BE PERFORMED USING METHODS AND INSTRUCTIONS SET FORTH BY THE MANUFACTURER CONTAINED WITHIN THESE DRAWINGS.
10. UNITS MUST BE ATTACHED TO CONCRETE OR STRUCTURAL COMPONENTS OF THE BUILDING. OUTER WALL COVERINGS OR DECORATIVE ATTACHMENTS THAT ARE NOT PART OF THE BUILDING STRUCTURE ARE NOT SUITABLE FOR MOUNTING.

CONSULTING ENGINEER  
THOMAS H. MAXWELL JR., P.E.  
121 N.W. 39 AVE.  
MIAMI, FLORIDA 33126  
(305) 541-7549

Board of Professional Engineers  
Exam: Mechanical-Structural: 1965  
State of Florida P.E. Registration  
No. 10150  
U.S. Army Corps of Engineers:  
Civil-Structural Engineer  
Florida Power & Light Company:  
Electrical Engineer

DRAWING INDEX

PAGE 1 OF 4 - GENERAL NOTES/INDEX

5 X 7 FIXED (ENHANCED)

PAGE 2 OF 4 - 5' X 7' FIXED, FACE MOUNT UNIT.

MATERIALS & FASTENER SCHEDULE

PAGE 3 OF 4 - SUBFRAME ASSEMBLY DETAILS


PAGE 4 OF 4 - COMPONENT/EXTRUSION DETAILS.

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 12-1019.17  
Expiration Date 3/18/2014  
By *[Signature]*  
Miami Dade Product Control


Approved as complying with the  
Florida Building Code  
Date 03/18/2009  
NOA 08-1607.05  
Miami Dade Product Control  
Division  
By *[Signature]*

*[Signature]*  
2-19-09


TITLE/CUSTOMER	
STORM SHIELD HURRICANE BARRIERS DRAWING INDEX/NOTES	
SCALE: NTS	DRAWN BY: RBM
DATE: 9/8/08	REVISED R2 2/12/09
	
242 W. 8TH ST. WYOMING PA 18644	
PRODUCT CONTROL CODE:	800-972-2478 FAX (570) 693-2575
	DRAWING NO. SSHB-E
	PAGE 1 OF 4

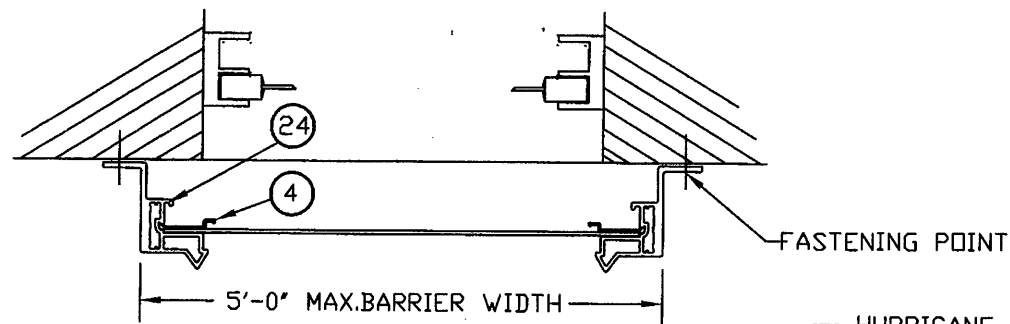


PLAN OF OPENING

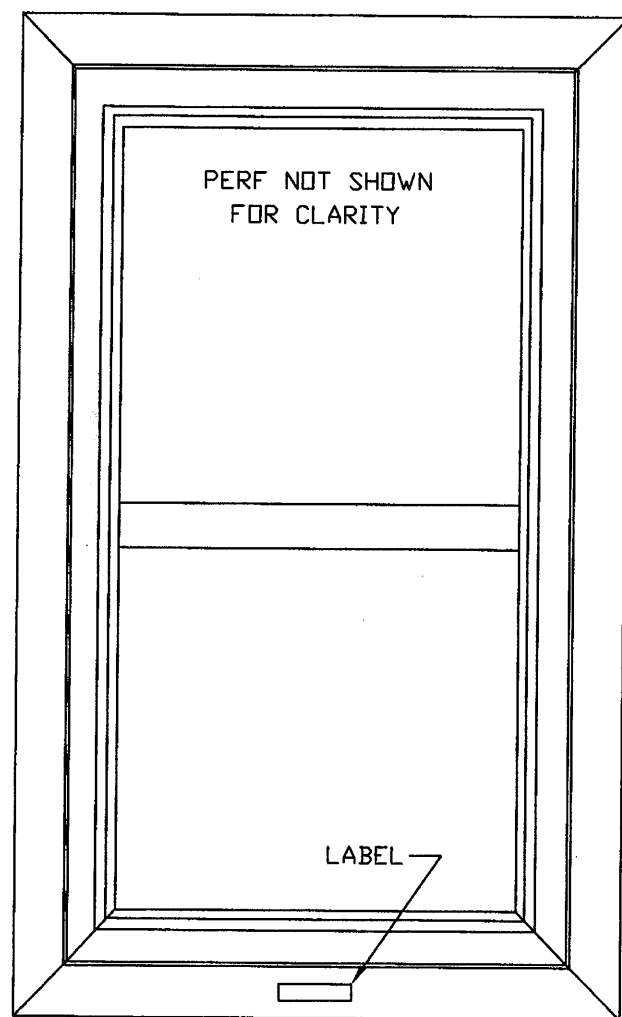

ELEVATION

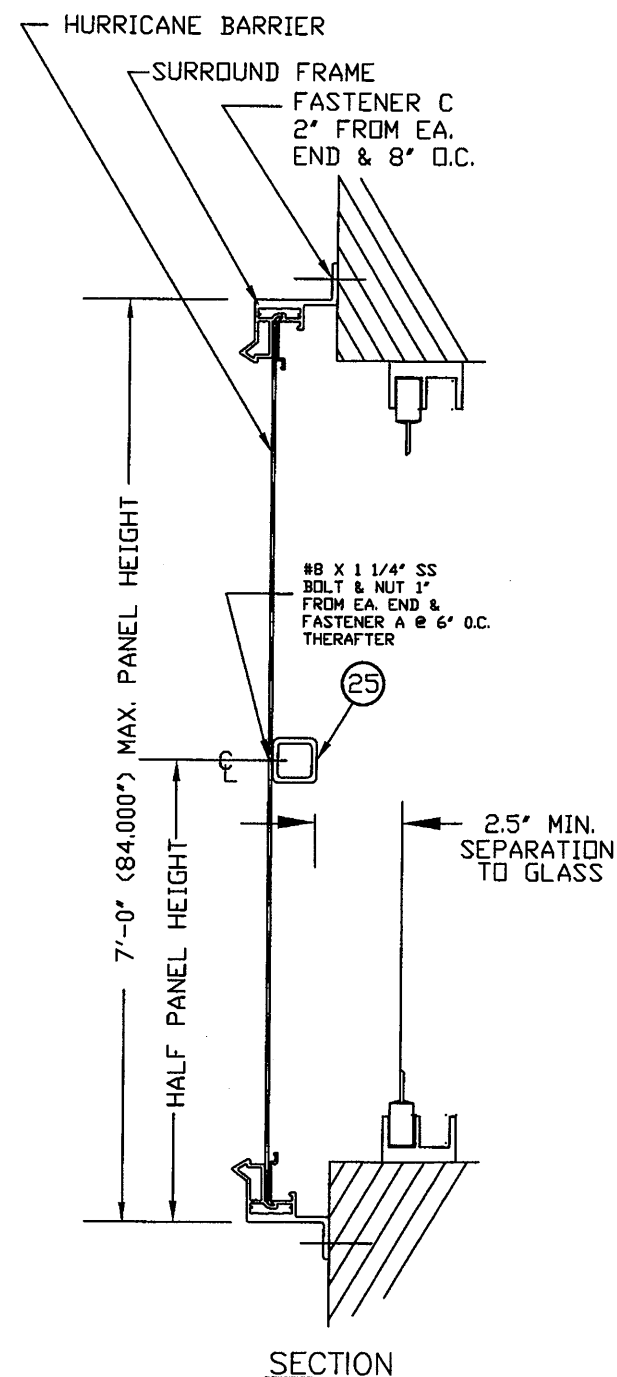

SECTION

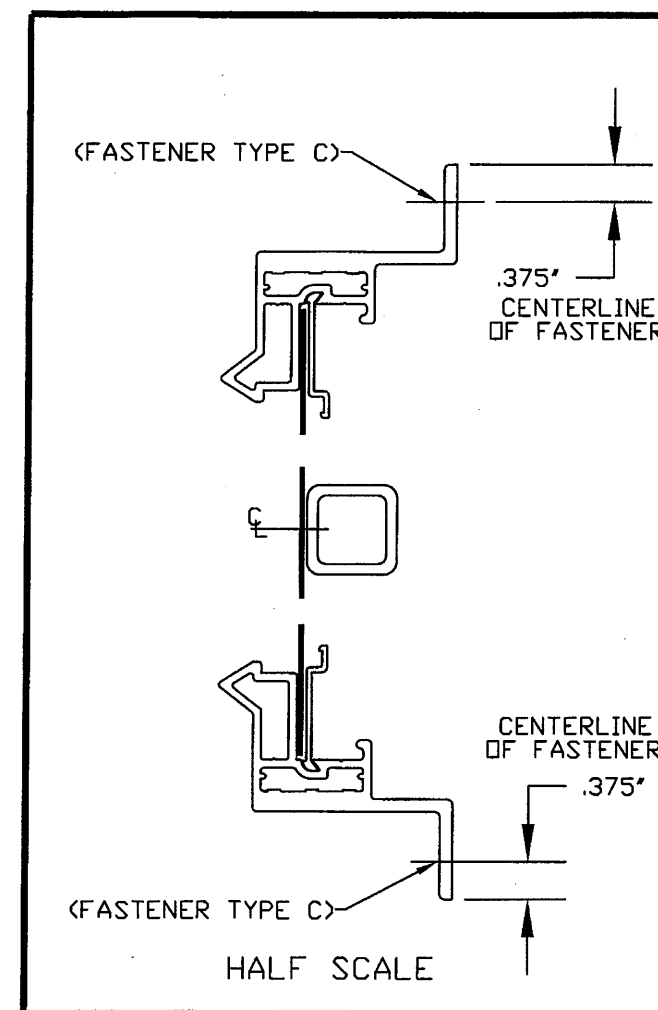

HALF SCALE

MID HEIGHT TUBE REQUIRED

MAT. TYPE	DESIGN PRESSURE RATING	
	POS. (PSF.)	NEG. (PSF.)
GALVANNEAL	80.00	80.00
STAINLESS STEEL	108.00	108.00

CONSULTING ENGINEER  
THOMAS H. MAXWELL JR., P.E.  
121 N.W. 39 AVE.  
MIAMI, FLORIDA 33126  
(305) 541-7549

Board of Professional Engineers  
Exam: Mechanical-Structural: 1965  
State of Florida P.E. Registration  
No. 10150  
U.S. Army Corps of Engineers:  
Civil-Structural Engineer  
Florida Power & Light Company:  
Electrical Engineer

TITLE/CUSTOMER		DETAILS FOR STORM SHIELD HURRICANE BARRIER 5' X 7' SINGLE FIXED	
SCALE:	NTS		DRAWN BY: RBM
DATE:	9/8/08		REVISED R2 2/12/09
242 W. 8TH ST. WYOMING PA 18644		800-972-2478 FAX (570) 693-2575	
PRODUCT CONTROL CODE:		DRAWING NO. SSHB-E	PAGE 2 OF 4

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 12-1019.17  
Expiration Date 3/10/2014  
*Alvin Am...*  
Miami Dade Product Control


Approved as complying with the  
Florida Building Code  
Date 03/18/2009  
NOA# 08-1067-05  
Miami Dade Product Control  
Division  
By *Helene A. ...*

*JSM*  
2-19-09

NOTES:


- FASTENER TYPE A: #10 X 5/8" SS TEK SCREW
- FASTENER TYPE B: #10 X 3/4" SS TEK SCREW
- FASTENER TYPE C: 1/4" X 1 3/4" ELCD TAPCON WITH 1.75" MINIMUM EMBEDMENT WITH FILLED CELLS.
- FOR SECURITY PURPOSES, THE 1" LEG CAN BE TURNED IN TO CONCEAL FASTENERS IF DESIRED.

# HURRICANE BARRIER SUBFRAME ASSEMBLY DETAILS

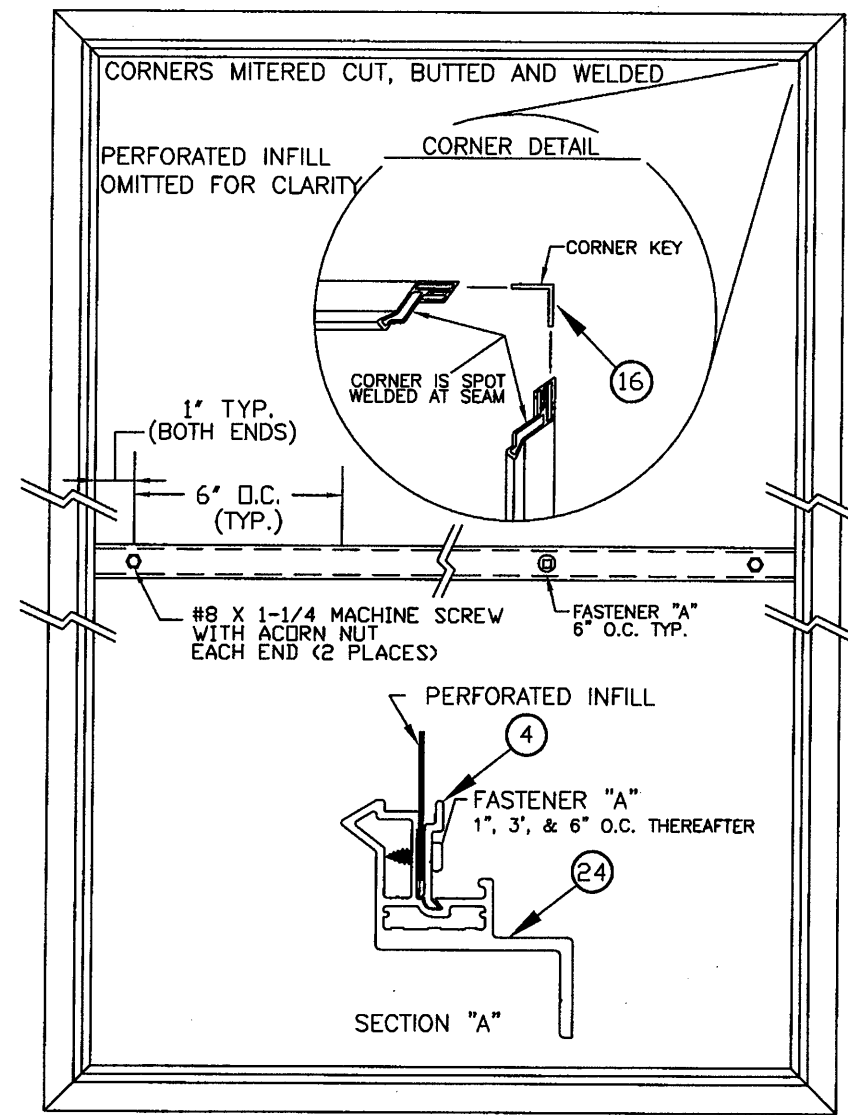

PANEL  
FRONT

FRONT

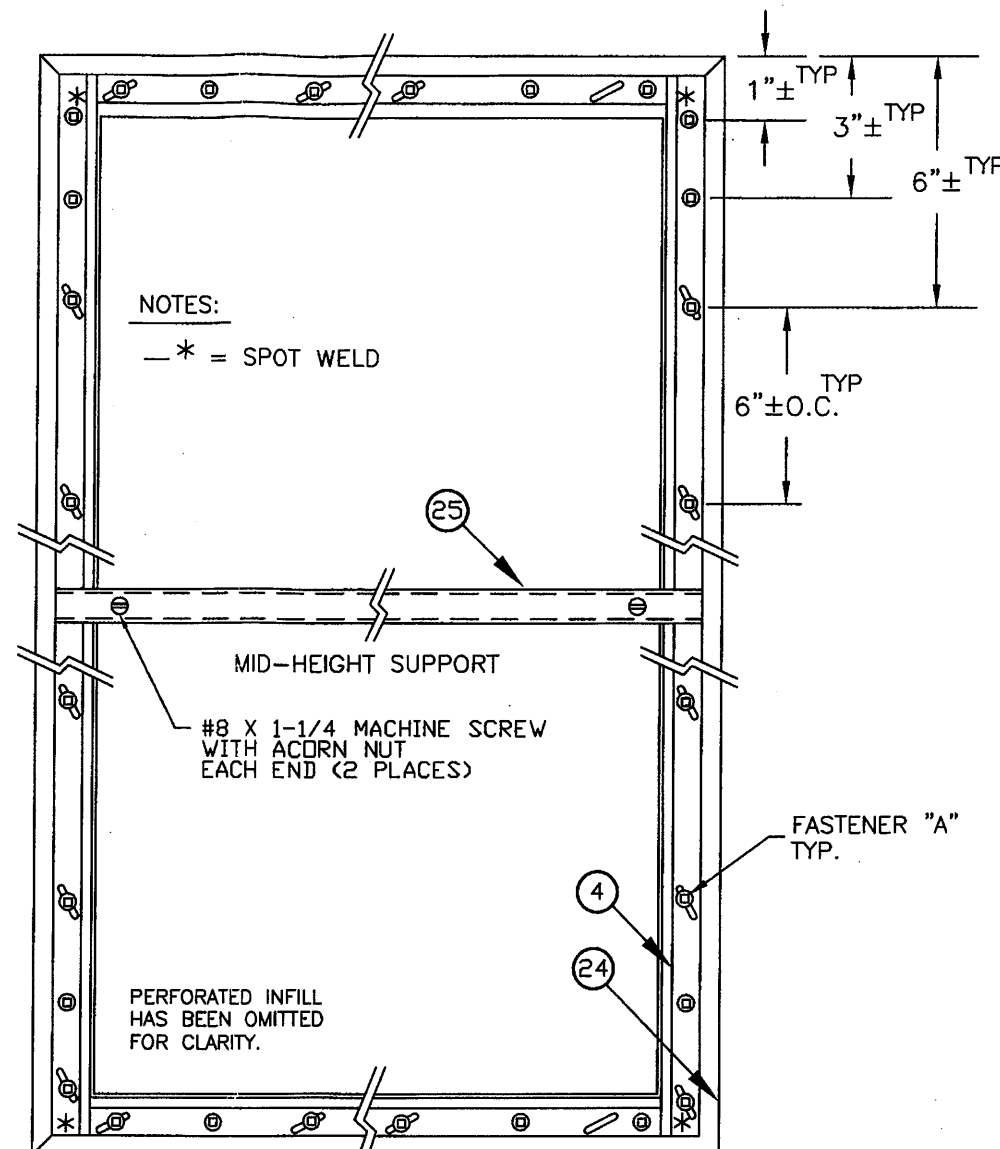

PANEL  
REAR

1 X 1 X 1/8 MIDHEIGHT SUPPORT:  
REQUIRED AS SHOWN ON OTHER DRAWINGS

CONSULTING ENGINEER  
THOMAS H. MAXWELL JR., P.E.  
121 N.W. 39 AVE.  
MIAMI, FLORIDA 33126  
(305) 541-7549  
Board of Professional Engineers  
Exam: Mechanical-Structural: 1965  
State of Florida P.E. Registration  
No. 10150  
U.S. Army Corps of Engineers:  
Civil-Structural Engineer  
Florida Power & Light Company:  
Electrical Engineer

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 12-1019.17  
Expiration Date 3/18/2014  
By *[Signature]*  
Miami Dade Product Control

Approved as complying with the  
Florida Building Code  
Date 03/18/2009  
NOAH 08-1007-05  
Miami Dade Product Control  
Division  
By *[Signature]*

*[Signature]*  
2-19-09

HARDWARE  
FASTENER A



FASTENER A  
#10X5/8"  
1' & 3' FROM CORNER  
AND 6' O.C. THEREAFTER



MACHINE SCREW  
#8 X 1-1/4 SS  
WITH ACORN NUT  
AT END OF MID-HEIGHT SUPP.

TITLE/CUSTOMER  
HURRICANE BARRIER SUBFRAME ASSEMBLY DETAILS

5' X 7' SINGLE FIXED

SCALE:  
NTS

DATE:  
9/8/08



WWW.STORMSHIELD.NET

DRAWN BY:  
RBM

REVISED  
R2 2/12/09



242 W. 8TH ST.  
WYOMING PA 18644

PRODUCT CONTROL CODE:

800-972-2478  
FAX (570) 693-2575

DRAWING NO. SSHB-E


PAGE 3 OF 4

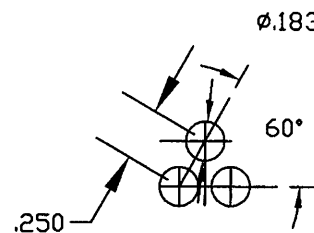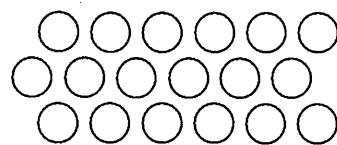


PERFORATED PATTERN:  
INVISIPERF II  
FULL SCALE

MATERIAL:  
.079" (NOMINAL THICKNESS)  
GALVANNEALED STEEL  
STRUCTURAL QUALITY GRADE  
33 WITH A60 GALVANNEAL  
COATING PER ASTM A653  
FINISHED WITH POLYESTER  
POWDER COAT.  
.0705" (MIN. THICKNESS)


OPTIONAL MATERIAL:  
.079" (NOMINAL THICKNESS)  
STAINLESS STEEL  
PREPARED USING  
ASTM A240 SPECIFICATION.  
WITH THESE MIN. REQUIREMENTS  
-TENSILE STRENGTH - 75 ksi. MIN.  
-YIELD STRENGTH - 30 ksi. MIN.  
-ELONGATION - 40% IN 2" MIN.  
-HARDNESS - 92 r.b. MAX.  
FINISHED WITH WEATHER  
RESISTANT, HIGH PERFORMANCE  
ELECTRO-STATIC APPLIED  
COATING.  
.0711" (MIN. THICKNESS)

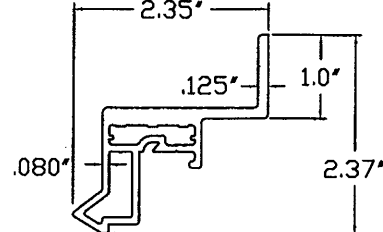


1x2 FIXED SUBFRAME COMBO  
(24) TYP. WALL .125  
6063 T5 ALLOY



(25) MID-HEIGHT SUPPORT TUBE  
TYP. WALL .063  
6063 T5 ALLOY



(4) BARRIER RAIL  
TYP. WALL 0.050  
6063 T5 ALLOY



(16) CORNER KEY  
TYP. WALL = .095  
6063 T5 ALLOY  
(INTERNAL PART)

CONSULTING ENGINEER  
THOMAS H. MAXWELL JR., P.E.  
121 N.W. 39 AVE.  
MIAMI, FLORIDA 33126  
(305) 541-7549  
Board of Professional Engineers  
Exam: Mechanical-Structural: 1965  
State of Florida P.E. Registration  
No. 10150  
U.S. Army Corps of Engineers:  
Civil-Structural Engineer  
Florida Power & Light Company:  
Electrical Engineer

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 12-1019.17  
Expiration Date 3/18/2014  
Miami Dade Product Control

Approved as complying with the  
Florida Building Code  
Date 03/18/2009  
NOAH 08-1007-05  
Miami Dade Product Control  
Division  
By: He Long A. Miller

2/19/09

TITLE/CUSTOMER			
DETAILS FOR STORM SHIELD HURRICANE BARRIER 5' X 7' SINGLE FIXED			
SCALE:	NTS		DRAWN BY: RBM
DATE:	9/8/08		REVISED R2 2/12/09
242 W. 8TH ST. WYOMING PA 18644		800-972-2478 FAX (570) 693-2575	DRAWING NO. SSHB-E
PRODUCT CONTROL CODE:		PAGE 4 OF 4	